

# LOAD VALVE SERIES VTC300

The thermic valve series ESBE VTC300 is used to protect boilers up to 30 kW from too low return temperatures. ESBE series VTC300 also efficiently loads accumulation tanks.



## OPERATION

The ESBE series VTC300 is a thermic 3-way valve designed to protect the boiler from return temperatures that are too low. Maintaining a high and stable return temperature means a higher level of boiler efficiency, reduced tarring and increased life span of the boiler. The VTC300 valve is used in heating applications up to 30 kW where solid fuel boilers are used to feed storage tanks. The valve is installed in the return pipe to the boiler. The option is recommended as it offers a simpler pipe layout for expansion (see installation examples).

## FUNCTION

The valve regulates on two ports, which makes it easy to install and does not require any adjustment valve in the bypass pipe.

The function of the valve is independent of its assembly position.

The valve contains a thermostat which begins to open connection A at an outgoing mixed water temperature in connection AB of 45°C, 55°C or 60°C. Connection B is fully closed when the temperature in connection A exceeds the nominal opening temperature with 10°C.

## MEDIA


Maximum 50% glycol for freezing protection and oxygen absorbing compounds are allowed as additives. As both the viscosity and the thermal conduction are affected when glycol is added to the system water, this fact has to be considered when dimensioning the valve. When 30 - 50 % glycol is added, the maximum output effect of the valve is decreased by 30 - 40 %. A lower concentration of glycol may be disregarded.

## SERVICE AND MAINTENANCE

We recommend equipping the valve connections with shut-down devices to facilitate future service.

The load valve does not need any maintenance under normal conditions. However thermostats are available and are easy to replace if necessary.

## INSTALLATION EXAMPLES

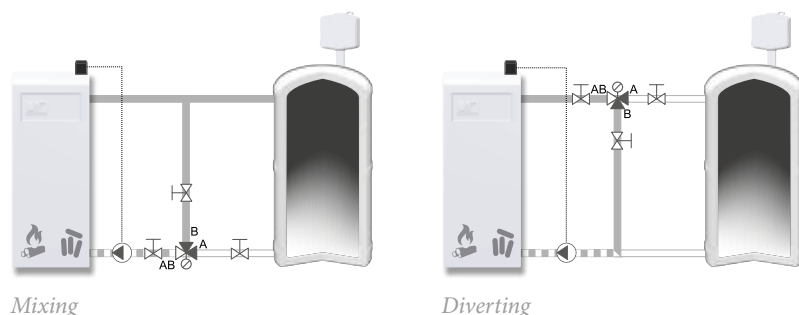

## LOAD VALVE VTC300 DESIGNED FOR

- Heating
- Solar heating

## OPTIONS

|                       |                   |
|-----------------------|-------------------|
| Thermostat 45°C _____ | Art. No. 57000100 |
| Thermostat 55°C _____ | Art. No. 57000200 |
| Thermostat 60°C _____ | Art. No. 57000300 |
| Thermostat 70°C _____ | Art. No. 57000400 |
| Thermostat 80°C _____ | Art. No. 57000500 |


## TECHNICAL DATA

Pressure class: \_\_\_\_\_ PN 10  
 Temperature of medium: \_\_\_\_\_ max 100°C  
 \_\_\_\_\_ min 0°C  
 Max. differential pressure: \_\_\_\_\_ Mixing, 100 kPa (1,0 bar)  
 Max. differential pressure: \_\_\_\_\_ Diverting, 30 kPa (0,3 bar)  
 Leakrate A - AB: \_\_\_\_\_ Tight sealing  
 Leakrate B - AB: \_\_\_\_\_ max 3% of Kvs  
 Rangeability Kv/Kv<sup>min</sup>: \_\_\_\_\_ 100  
 Connections: \_\_\_\_\_ Internal thread (G), EN 10226-1  
 \_\_\_\_\_ External thread (G), ISO 228/1  
 Media: \_\_\_\_\_ Heating water (in accordance with VDI2035)  
 \_\_\_\_\_ Water / Glycol mixtures, max. 50%  
 \_\_\_\_\_ Water / Ethanol mixtures, max. 28%  
 Material  
 Valve housing and other metal parts with fluid contact:  
 \_\_\_\_\_ Brass DZR, CW 625N, resistant to dezincification


PED 2014/68/EU, article 4.3

Pressure Equipment in conformity with PED 2014/68/EU, article 4.3 (sound engineering practice). According to the directive the equipment shall not carry any CE mark.



## FLOW PATTERN

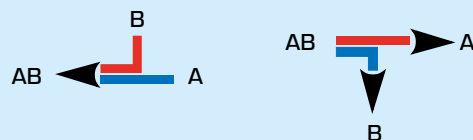


# LOAD VALVE SERIES VTC300

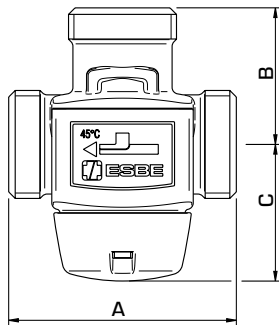

VTC311, VTC312

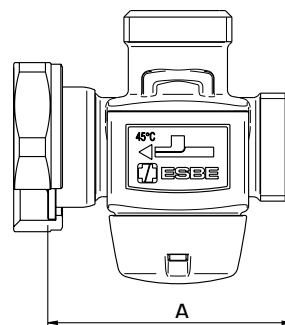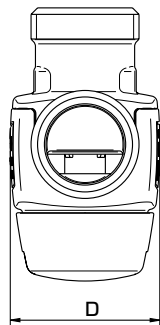

VTC317

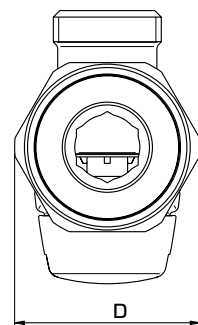

## SERIES VTC311, INTERNAL THREAD

| Art. No. | Reference | DN | Kvs * | Connection | Opening temperature | A  | B  | C  | D  | Weight [kg] | Note |
|----------|-----------|----|-------|------------|---------------------|----|----|----|----|-------------|------|
| 51000100 | VTC311    | 20 | 3,2   | Rp 3/4"    | 45°C ± 2°C          | 70 | 42 | 42 | 46 | 0,53        |      |
| 51000200 |           |    |       |            | 55°C ± 2°C          |    |    |    |    |             |      |
| 51000300 |           |    |       |            | 60°C ± 2°C          |    |    |    |    |             |      |

## SERIES VTC312, EXTERNAL THREAD

| Art. No. | Reference | DN | Kvs * | Connection | Opening temperature | A  | B  | C  | D  | Weight [kg] | Note |
|----------|-----------|----|-------|------------|---------------------|----|----|----|----|-------------|------|
| 51000800 | VTC312    | 15 | 2,8   | G 3/4"     | 45°C ± 2°C          | 70 | 42 | 42 | 46 | 0,48        |      |
| 51000900 |           |    |       |            | 55°C ± 2°C          |    |    |    |    |             |      |
| 51001000 |           |    |       |            | 60°C ± 2°C          |    |    |    |    |             |      |
| 51001500 | VTC312    | 20 | 3,2   | G 1"       | 45°C ± 2°C          | 70 | 42 | 42 | 46 | 0,51        |      |
| 51001600 |           |    |       |            | 55°C ± 2°C          |    |    |    |    |             |      |
| 51001700 |           |    |       |            | 60°C ± 2°C          |    |    |    |    |             |      |

## SERIES VTC317, PUMP FLANGE AND EXTERNAL THREAD

| Art. No. | Reference | DN | Kvs * | Connection      | Opening temperature | A  | B  | C  | D  | Weight [kg] | Note |
|----------|-----------|----|-------|-----------------|---------------------|----|----|----|----|-------------|------|
| 51002300 | VTC317    | 20 | 3,2   | PF 1 1/2", G 1" | 55°C ± 2°C          | 75 | 42 | 42 | 57 | 0,57        |      |
| 51002400 |           |    |       |                 | 60°C ± 2°C          |    |    |    |    |             |      |

\* Kvs-value in m<sup>3</sup>/h at a pressure drop of 1 bar. PF = Pump Flange

# LOAD VALVE SERIES VTC300

## DIMENSIONING OF VALVE AND PUMP

**Example:** Start with the heat output of the boiler (e.g. 20 kW) and move horizontally to the right in the diagram to the chosen  $\Delta t$ , which is the temperature difference between the riser from the boiler and the return to the boiler (e.g.  $90^{\circ}\text{C} - 80^{\circ}\text{C} = 10^{\circ}\text{C}$ ).

Move vertically up to the curves representing the different valve sizes (e.g. Kvs 2.8) and then move horizontally to the left to find the pressure drop over the valve (e.g. 38kPa) which the pump will have to overcome. In addition to the pressure drop over

the valve, remember that the pump will also have to be dimensioned to handle the pressure drop in the rest of the system (e.g. pipes, boiler and accumulation tank).

If the pressure drop and flow do not match the pump you have intended for the system, please try a different Kvs-value to receive a suitable pressure drop.

## VTC300 – pressure losses

$\Delta P$   
[kPa] [m]

